

NORTHROP EXHIBIT Q

M. M. Lang

New Device

17 Ω 4.50 V \pm 98 °C \pm 2 (?)

0.20 A

Brick


Homogeneous
direction
w/ UV
lightb) 2nd device: 37 Ω 5.89 V 0.17 A \approx 98 °C

Experiment

Try 20 cycles

1 minute each

(2 minute total/cycle)

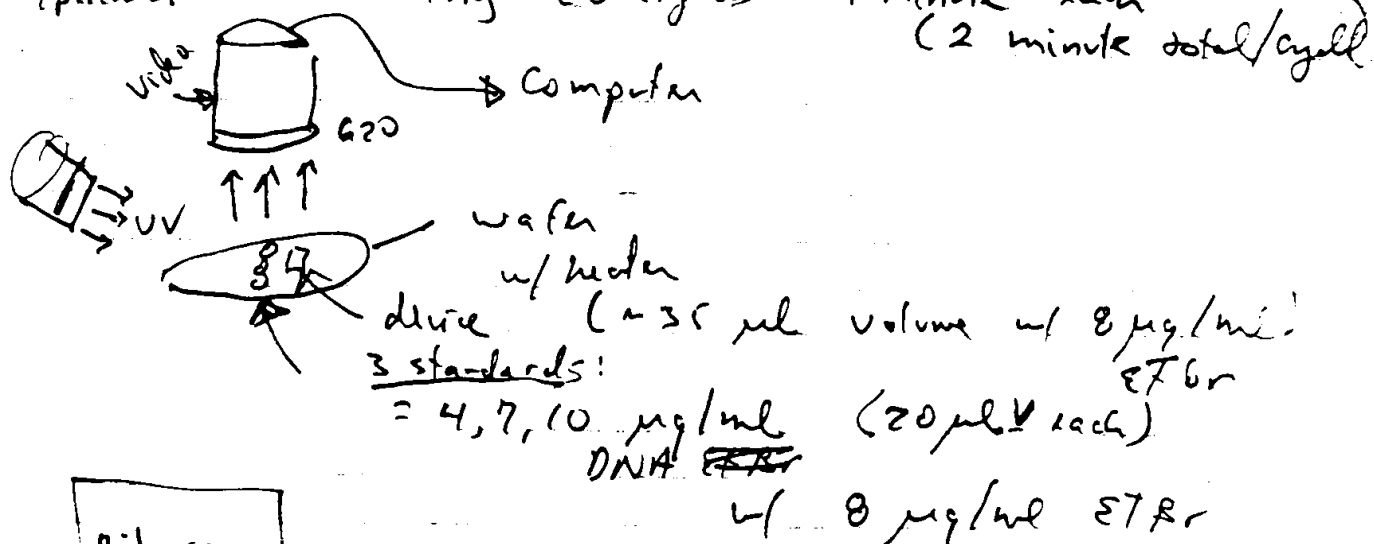

0:1 ran out

Try again!

reload w/ same rxn mixture

rxn = 25 μ l on device

Homogeneous did not work

- Note standards weren't even consistent

- Try w/ new batch of .4 x .4 cm² heater wells